

**ALoMCP Flowchart G59/3-7 Compliance**

**Key**  
 PGM = Power Generating Module – each set of non-synchronous turbines or inverters treated collectively and each separate synchronous machine

PGM Protection = any protection that might be implemented in the PGM, eg G59 settings in inverters etc, but also including any voltage or frequency related protection in machine controllers etc

DFIG = Double fed induction generator.


**Relay change/installation activity** – each instance attracts £4k. No limit per site.

**Setting or deactivation** – first instance on a site attracts £1.5k. Subsequent instances attract £0.5k. Limit of £4.0k per site.

Note – G59/3-1 is the version of G59 that required all generation >5MW to either have RoCoF with revised settings, or VS.

G59/3-4 required that all new sites only have the revised RoCoF and no VS from 01/02/18.

G59/3-7 made the requirements of G59/3-4 retrospective.

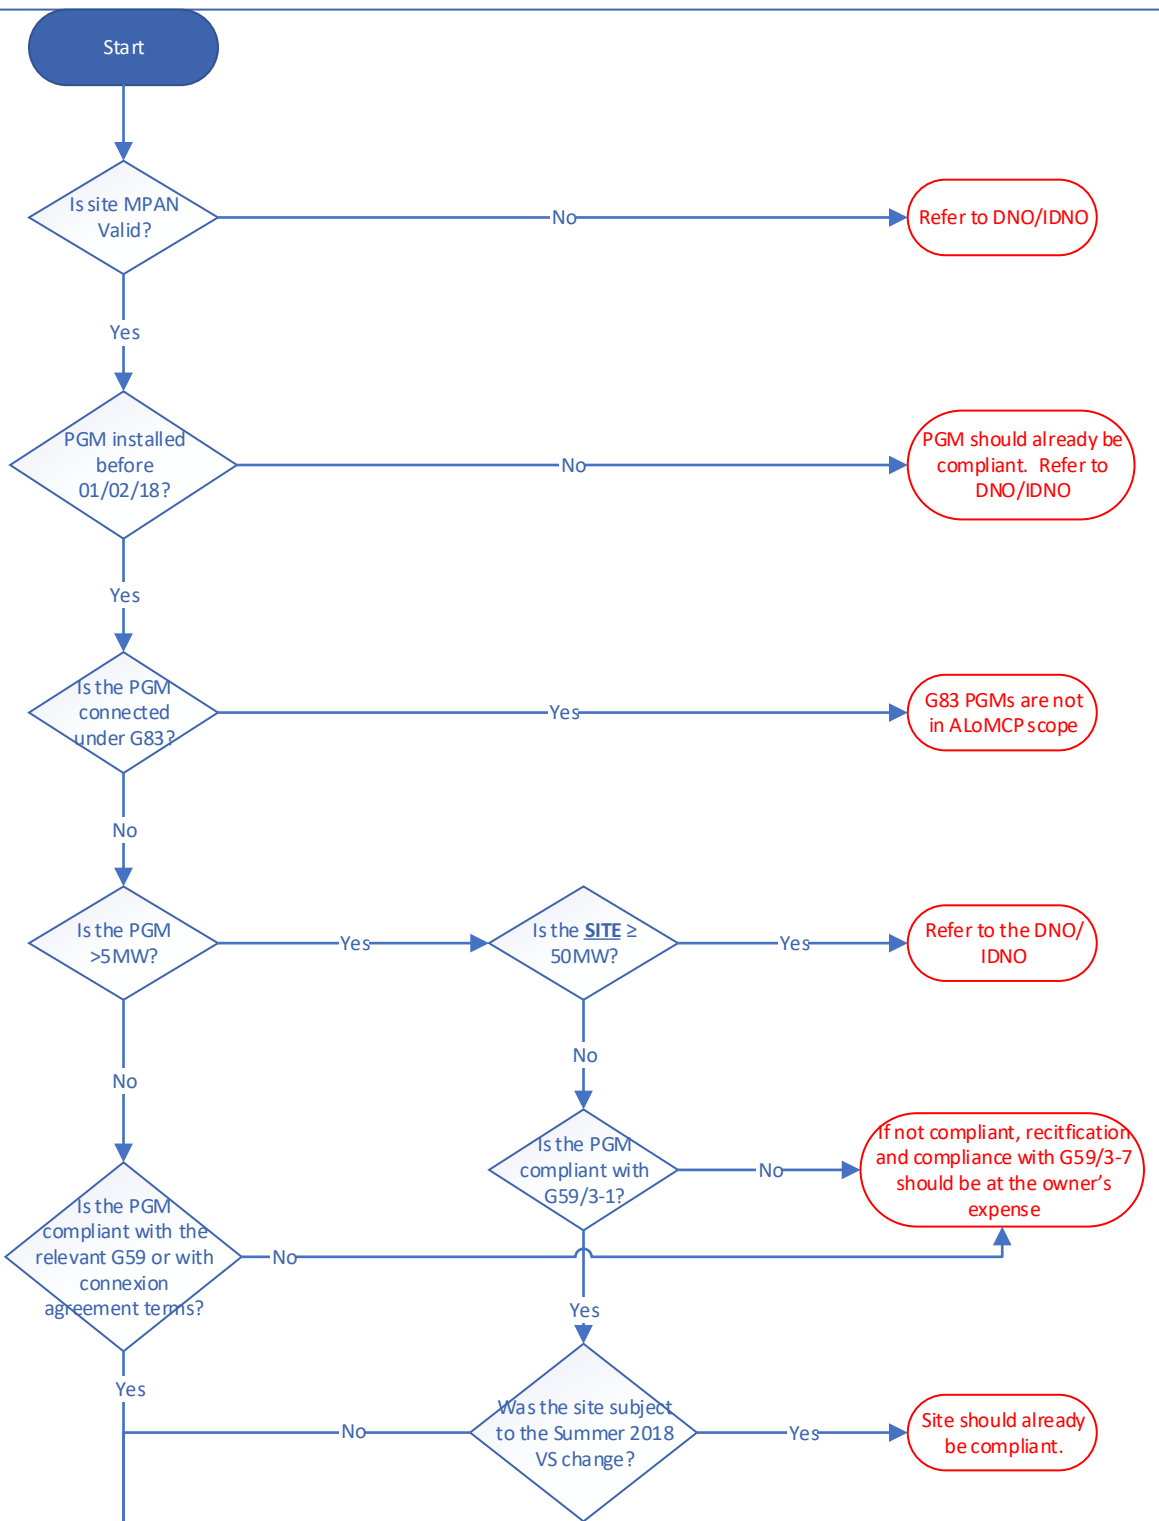

**Repeat these actions for all PGMs on the site**

